


Wastewater Utility 2019 Monthly Report



January 2019

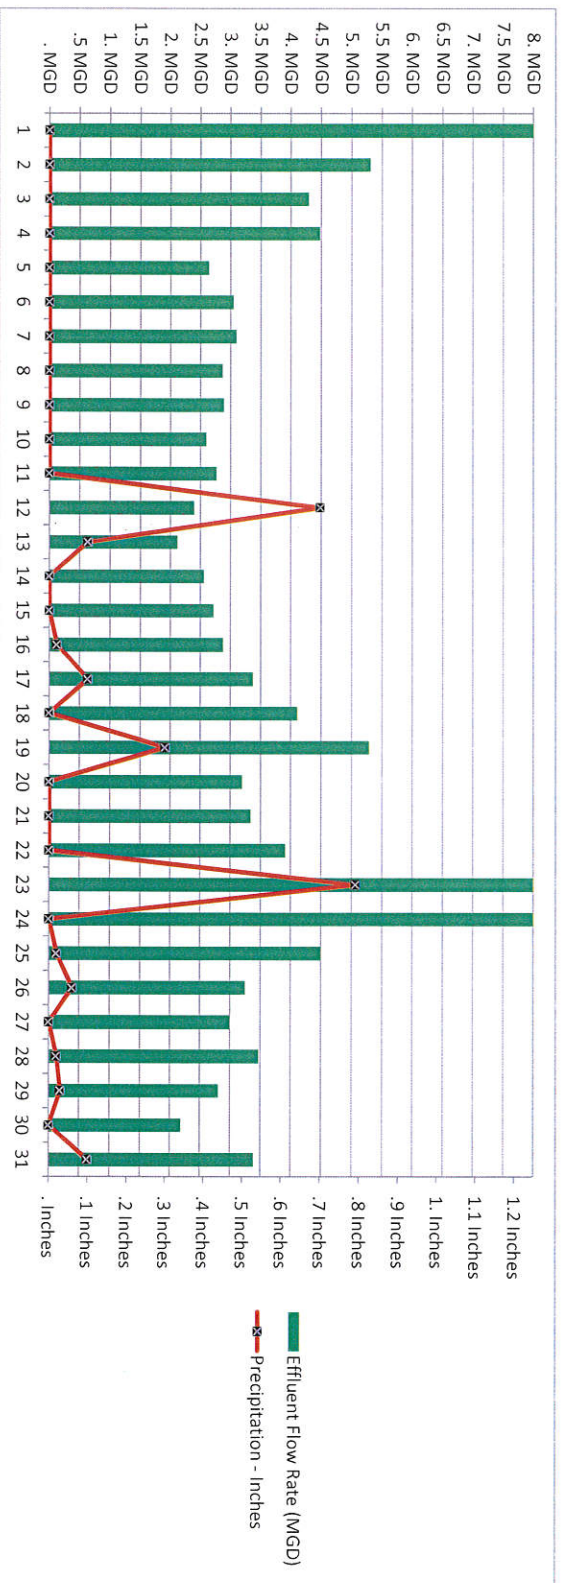

Month	January	February	March	April	May	June	July	August	September	October	November	December	Total
Total MG Treated Effluent 2019	123.30												123.3
Total MG Treated Effluent 2018	91.20	125.71	114.45	126.25	75.78	85.60	98.27	115.29	132.71	79.28	120.06	97.73	1262.33
Total Monthly Precipitation 2019	2.24												2.24

2019 Monthly Percent Capacity	99%												
Actual Design Flow 4.0 MGD													

Sewer Crew Activities

- Catch Basins Repaired
- Small Lift Station Issues
- New Laterals Inspected
- Major Projects Completed
- Other Projects
- School & 6th, Pratt & Grant
- The Pump At John Deere Had To Be Pulled & One At The Animal Hospital Pulled Twice
- To Help Widen A Drive, New Culvert Pipes Were Installed For The Christian Church
- Storm Sewer System Was Being Cleaned Close To The Broadway - North Street Area

Plant Crew Activities

- Sludge Pressed / Gallons
- Motors Repaired/Replaced
- System Repairs
- 683,800
- The #1 RAS Pump Is Being Replaced After A Catastrophic Failure
- The #4 RAS Pump Was Again Sent In For Warranty Service
- Plant Crews Repaired #1 & #2 Primary Tanks In The Deep Freeze
- And Just In Time To Make Repairs To #3 & #4 Primaries
- A Deep Cold Snap After Heavy Rain Caused Numerous Problems
- #1 Sludge Pump Had To Be Dismantled And Repaired
- Haulers Were In To Transport Biosolids From Our Facility