


Wastewater Utility 2019 Monthly Report



June 2019

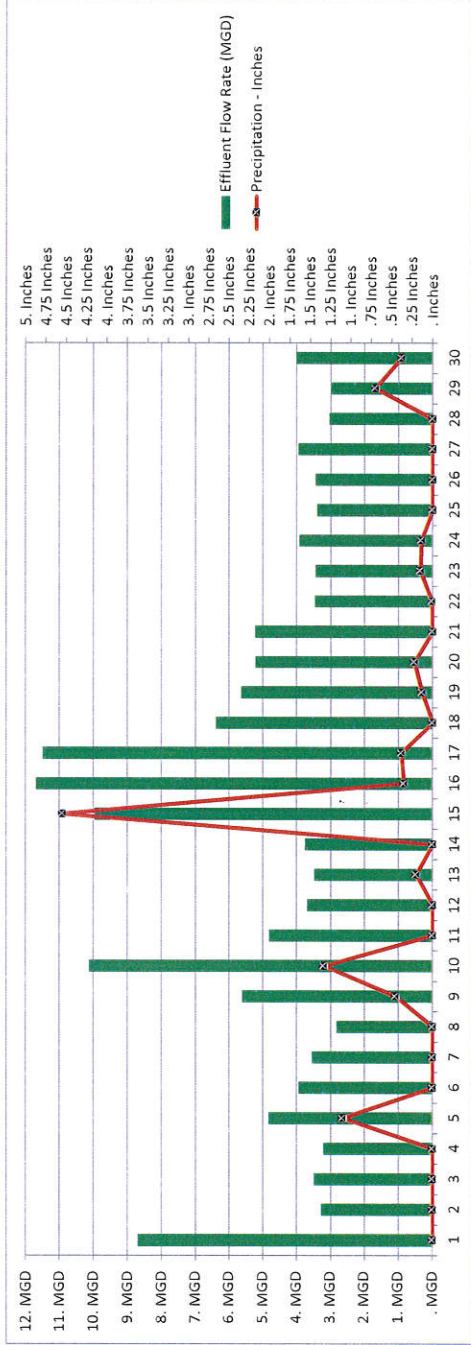

| Month | January | February | March | April | May | June | July | August | September | October | November | December | Total |
|----------------------------------|---------|----------|--------|--------|--------|--------|-------|--------|-----------|---------|----------|----------|---------|
| Total MG Treated Effluent 2019 | 123.30 | 138.30 | 122.91 | 154.54 | 127.04 | 152.68 | 98.27 | 115.29 | 132.71 | 79.28 | 120.06 | 97.73 | 818.77 |
| Total MG Treated Effluent 2018 | 91.20 | 125.71 | 114.45 | 126.25 | 75.78 | 85.60 | | | | | | | 1262.33 |
| Total Monthly Precipitation 2019 | 2.24 | 6.52 | 4.89 | 6.58 | 7.77 | 10.09 | | | | | | | 38.09 |

| | | | | | | | | | | | | | |
|-------------------------------|-----|------|-----|------|------|------|--|--|--|--|--|--|--|
| 2019 Monthly Percent Capacity | 99% | 123% | 99% | 129% | 102% | 127% | | | | | | | |
| Actual Design Flow 4.0 MGD | | | | | | | | | | | | | |

Sewer Crew Activities

1. Performed 19 lateral inspections
2. Completed 1 emergency lateral replacement
3. Repaired 6 storm catch basins
4. Replaced storm pipe on South Broadway
5. Cleaned/jetted 7570 feet of sanitary lines
6. Videoed lines on SR 9
7. Completed system inspections after heavy rain event; located numerous areas of storm infiltration into the sanitary system.
8. Installed back flow/check valve at the police dept.

Plant Crew Activities

- Sludge Pressed / Gallons
Plant Maintenance and Repairs:
- 631,800
1. UV system damaged by flooding; setup and installed temp chemical feeds for disinfection. Waiting to get final decision from IDEM on the permit change to disinfection.
 2. Pumped down and cleaned chlorine contact tank with help from the collection system staff.
 3. Replaced emergency eyewash in the lab.
 4. Replaced comb bar on fine screen.
 5. Completed all preventative maintenance as required.
 6. Total of 21 loads of bio-solids were hauled off-site by Soils Plus for a total of 311.18 wet tons.